

FIGURE 4. TYPICAL R.O. SYSTEM BEFORE INSTALLATION OF PERMEATE PUMP

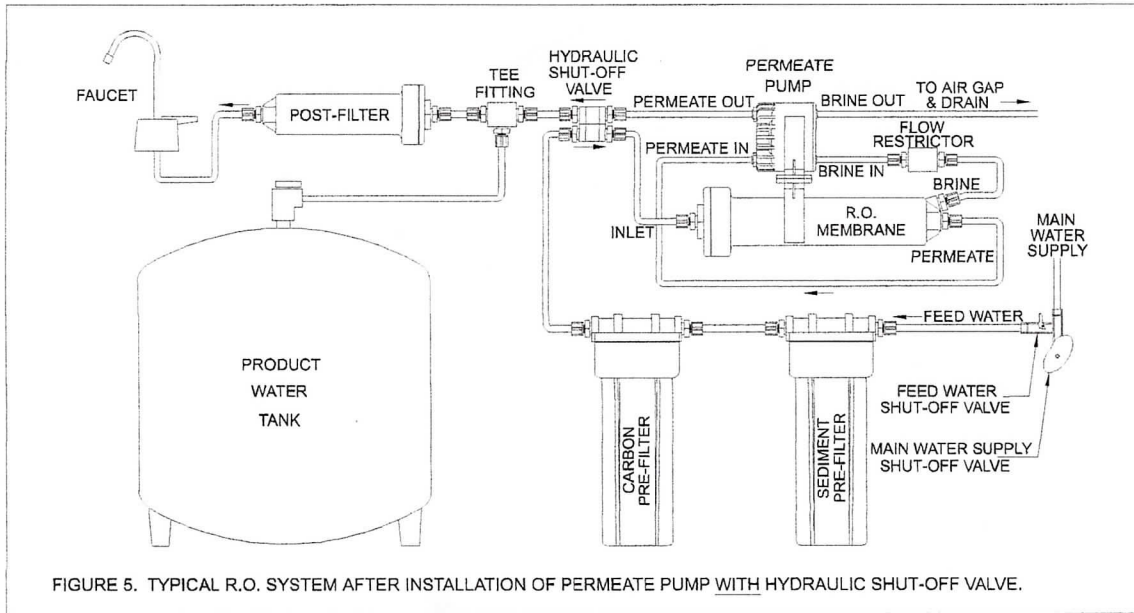


FIGURE 5. TYPICAL R.O. SYSTEM AFTER INSTALLATION OF PERMEATE PUMP WITH HYDRAULIC SHUT-OFF VALVE.

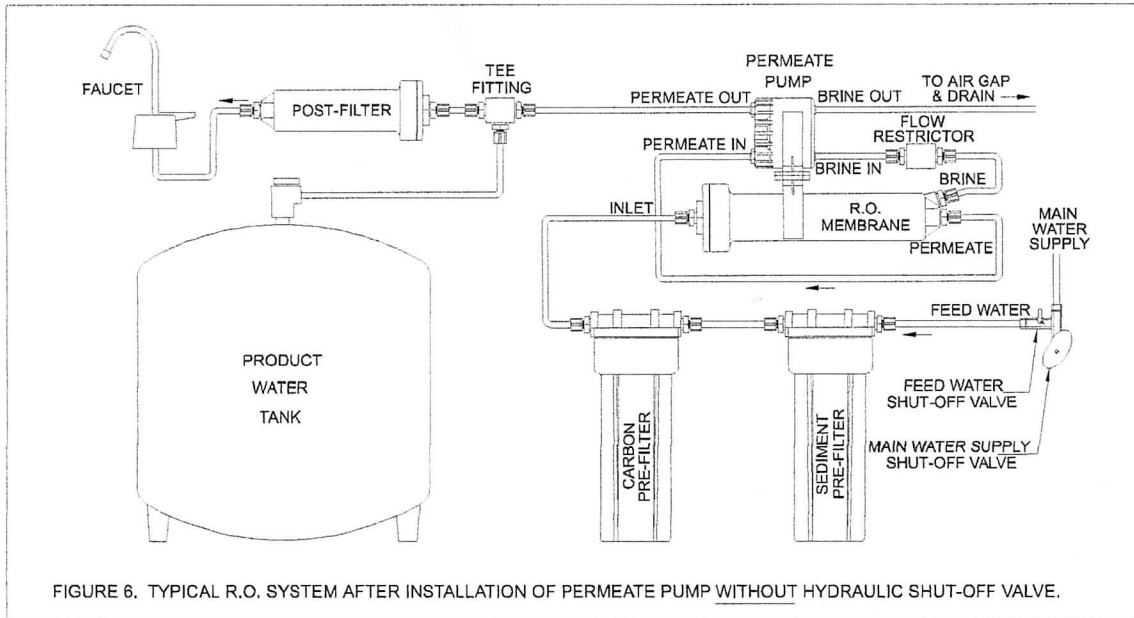


FIGURE 6. TYPICAL R.O. SYSTEM AFTER INSTALLATION OF PERMEATE PUMP WITHOUT HYDRAULIC SHUT-OFF VALVE.